



签 发 人:_____

中国上海普陀区曹杨路 800 号 1 幢 C 区 3 层

证书编号: TILVA202516009007


附 件

	NM5-1250 , NM5S-1250 ; NM5-1600 , NM5S-1600 ;
	NM5-1250S F H Q R U;NM5P-1250S F H Q R U; NM5T-1250S F H Q R U;NM5F-1250S F H Q R U; NM5H-1250S F H Q R U;NM5J-1250S F H Q R U; NM5G-1250S F H Q R U;NM5NE-1250S F H Q R U; NM5DC-1250Q U;NM5NEDC-1250Q U; NM5S-1250S F H Q R U; NM5NES-1250S F H Q R U; NM5PS-1250S F H Q R U; NM5TS-1250S F H Q R U; NM5FS-1250S F H Q R U; NM5HS-1250S F H Q R U; NM5JS-1250S F H Q R U; NM5GS-1250S F H Q R U; NM5-1600S F H Q R U; NM5P-1600S F H Q R U; NM5T-1600S F H Q R U; NM5F-1600S F H Q R U; NM5H-1600S F H Q R U; NM5J-1600S F H Q R U; NM5G-1600S F H Q R U; NM5NE-1600S F H Q R U; NM5DC-1600Q U NM5NEDC-1600Q U NM5S-1600S F H Q R U; NM5NES-1600S F H Q R U; NM5PS-1600S F H Q R U; NM5TS-1600S F H Q R U; NM5FS-1600S F H Q R U; NM5HS-1600S F H Q R U; NM5JS-1600S F H Q R U; NM5GS-1600S F H Q R U; Uimp:12kV; Ui:1600V; Ue: AC380V/AC400V/AC415V AC440V AC500V/AC550V AC630V AC660V/AC690V AC800V AC1000V/AC1140V DC500V DC600/DC630V DC750V DC1000V DC1500V AC380V/AC400V/AC415V AC440V AC500V/AC550V AC630V AC660V/AC690V In:800A 900A 1000A 1250A(NM5□□-1250) In:800A 900A 1000A 1250A 1400A 1500A 1600A (NM5□□-1600) :



中国上海普陀区曹杨路 800 号 1 幢 C 区 3 层 200063

<http://www.tilva.com>

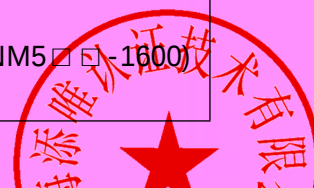


证书编号: TILVA202516009007

附 件

S	(AC380/AC400V/AC415V)/AC440V/(AC500V/AC550V)/(AC660V/AC690V) Ics=36kA/36kA/30kA/30kA Icu=50kA/50kA/40kA/30kA
F	(AC380/AC400V/AC415V)/AC440V/(AC500V/AC550V)/(AC660V/AC690V)/ AC800V/(AC1000V/AC1140V) Ics=Icu=50kA/50kA/40kA/30kA/30kA/25kA
H	(AC380/AC400V/AC415V)/AC440V/(AC500V/AC550V)/(AC660V/AC690V) Ics=50kA/50kA/40kA/30kA Icu=70kA/65kA/50kA/30kA
Q	(AC380/AC400V/AC415V)/AC440V/(AC500V/AC550V)/(AC660V/AC690V)/ AC800V/(AC1000V/AC1140V) Ics=70kA/65kA/50kA/30kA/30kA/30kA Icu=70kA/65kA/50kA/50kA/36kA/30kA Ics=Icu DC500V(3P 2):70kA (DC600V/DC630V)(3P 2):50kA DC750V(3P 3):70kA DC1000V(4P 4):70kA DC1500V 4P 4 :36kA
R	(AC380/AC400V/AC415V)/AC440V/(AC500V/AC550V)/AC630V/(AC660V/AC690V) Ics=70kA/65kA/50kA/40kA/40kA Icu=100kA/70kA/65kA/58kA/55kA;
U	(AC380/AC400V/AC415V)/AC440V/(AC500V/AC550V)/AC630V/(AC660V/AC690V)/AC800V/(AC1000V/AC1140V) Ics=100kA/70kA/60kA/50kA/42kA/36kA/30kA Icu=120kA/85kA/70kA/65kA/65kA/40kA/36kA Ics=Icu: DC500V(3P 2):80kA;DC600V/DC630V(3P 2)



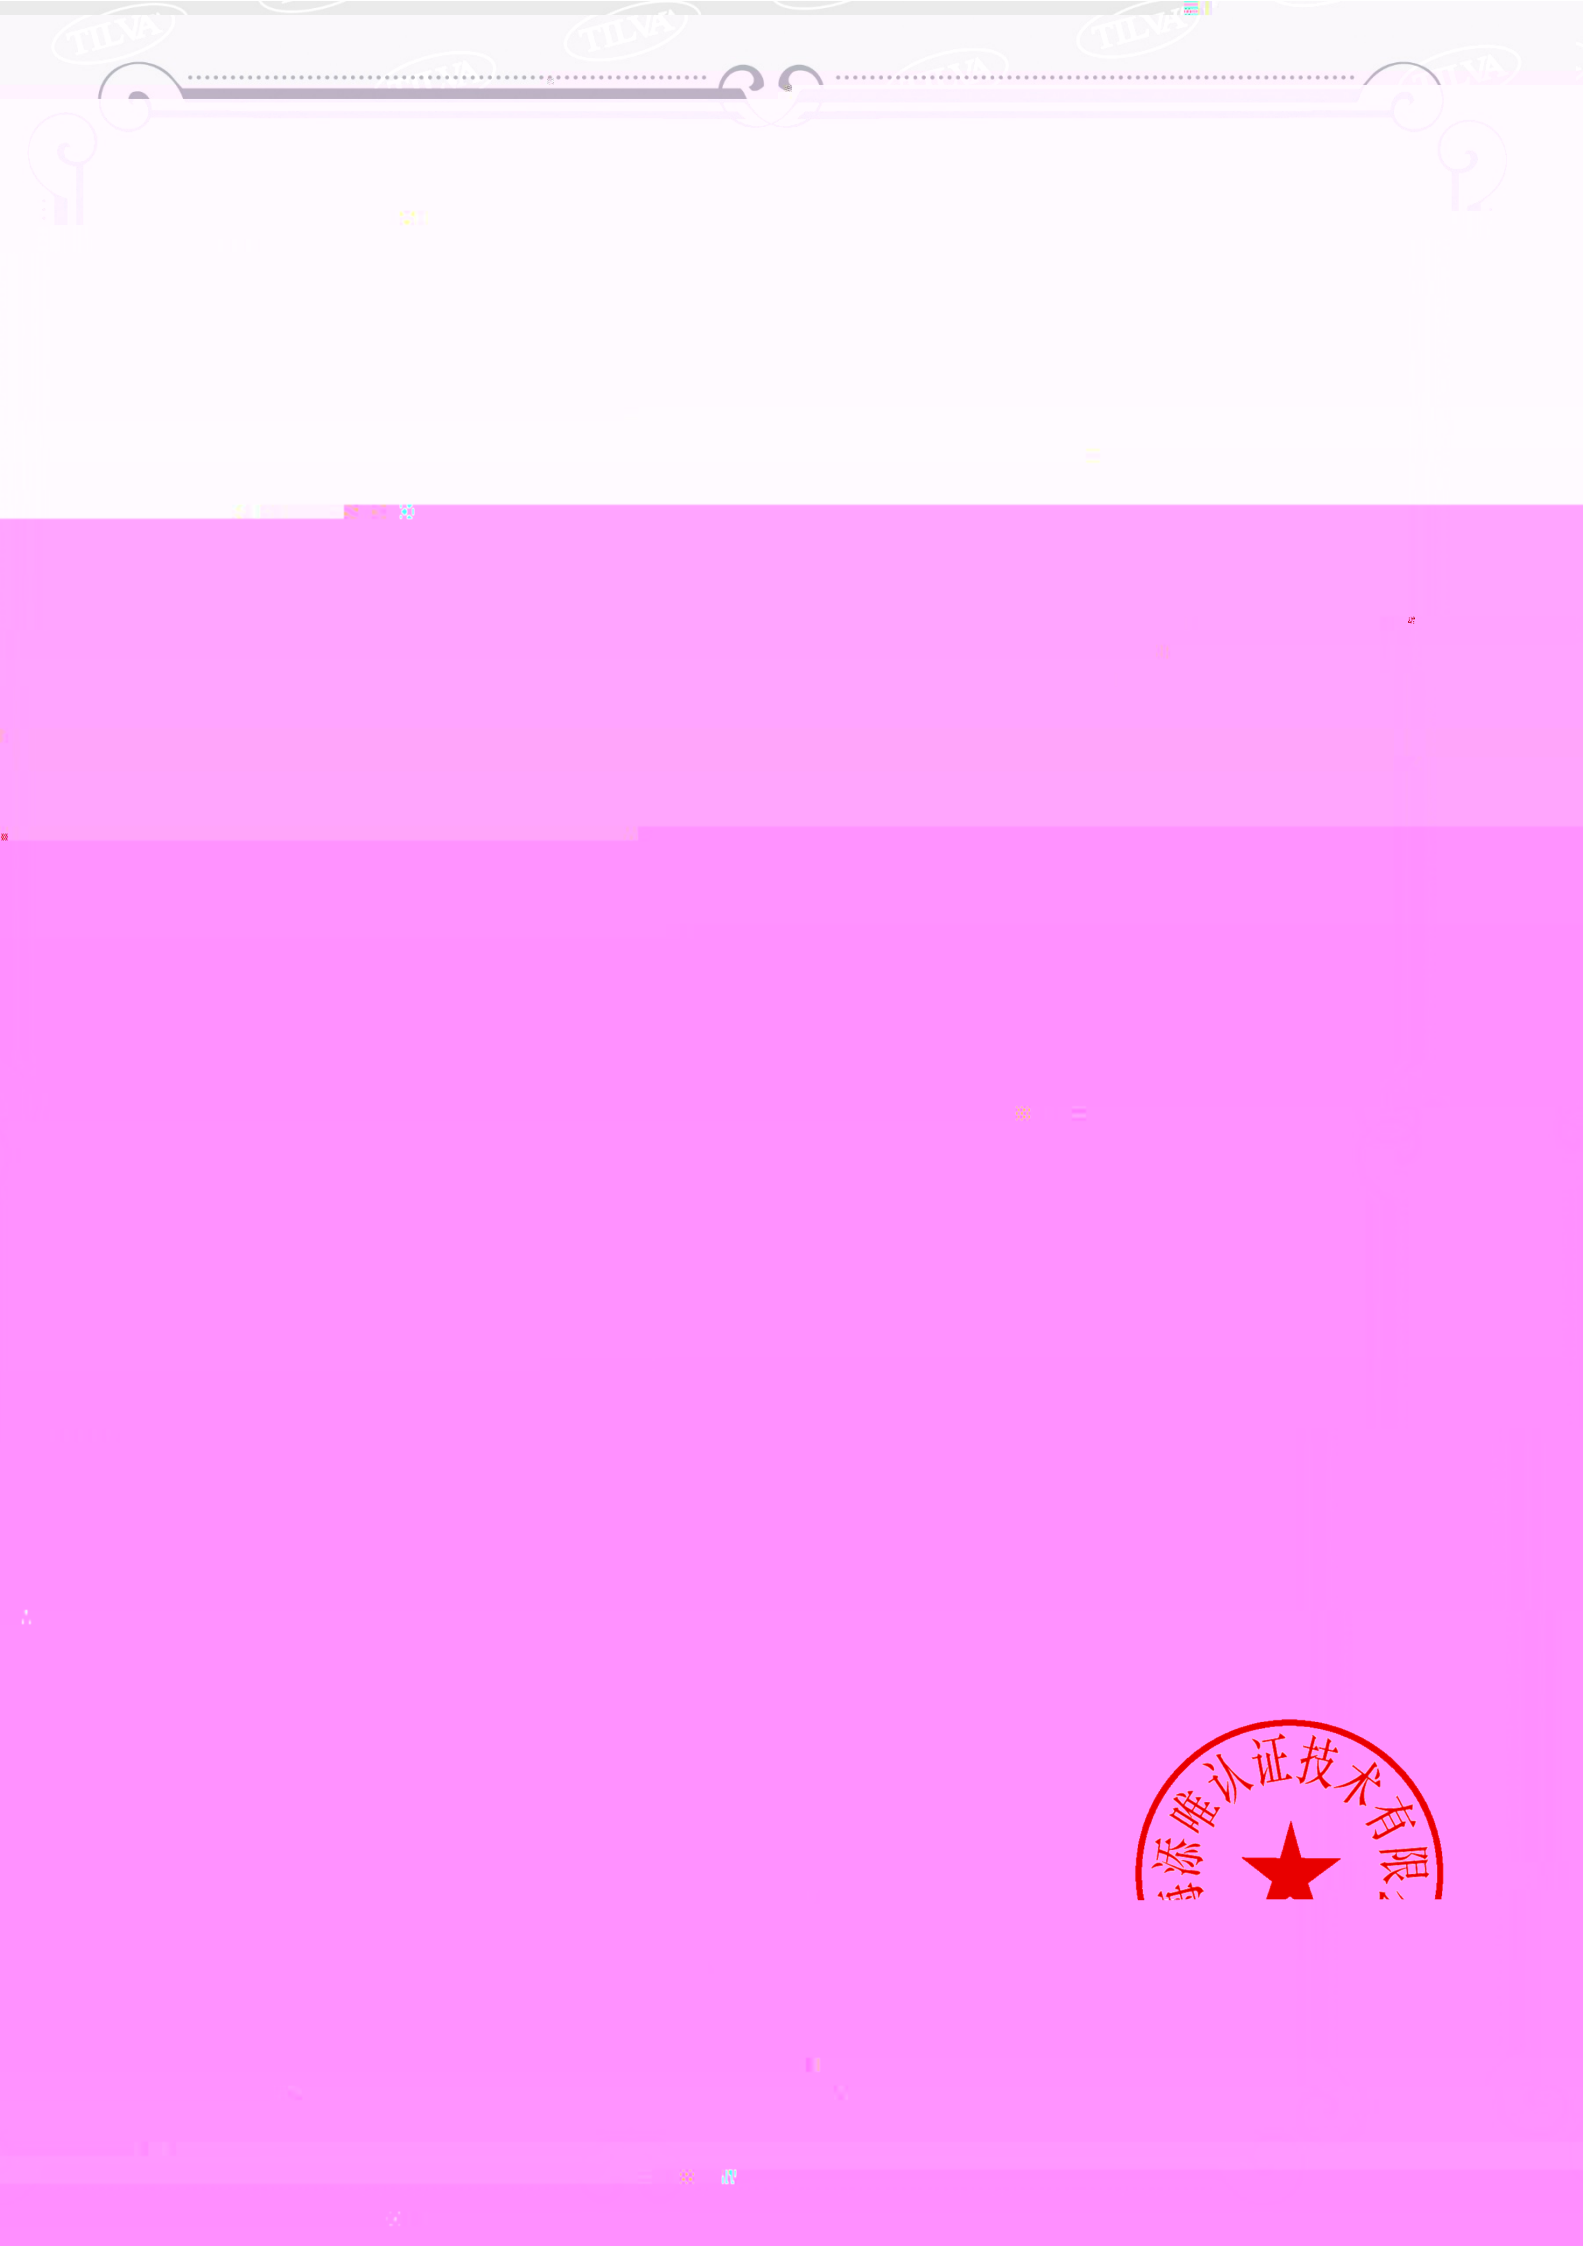

证书编号: TILVA202516009007

附 件

--	--

